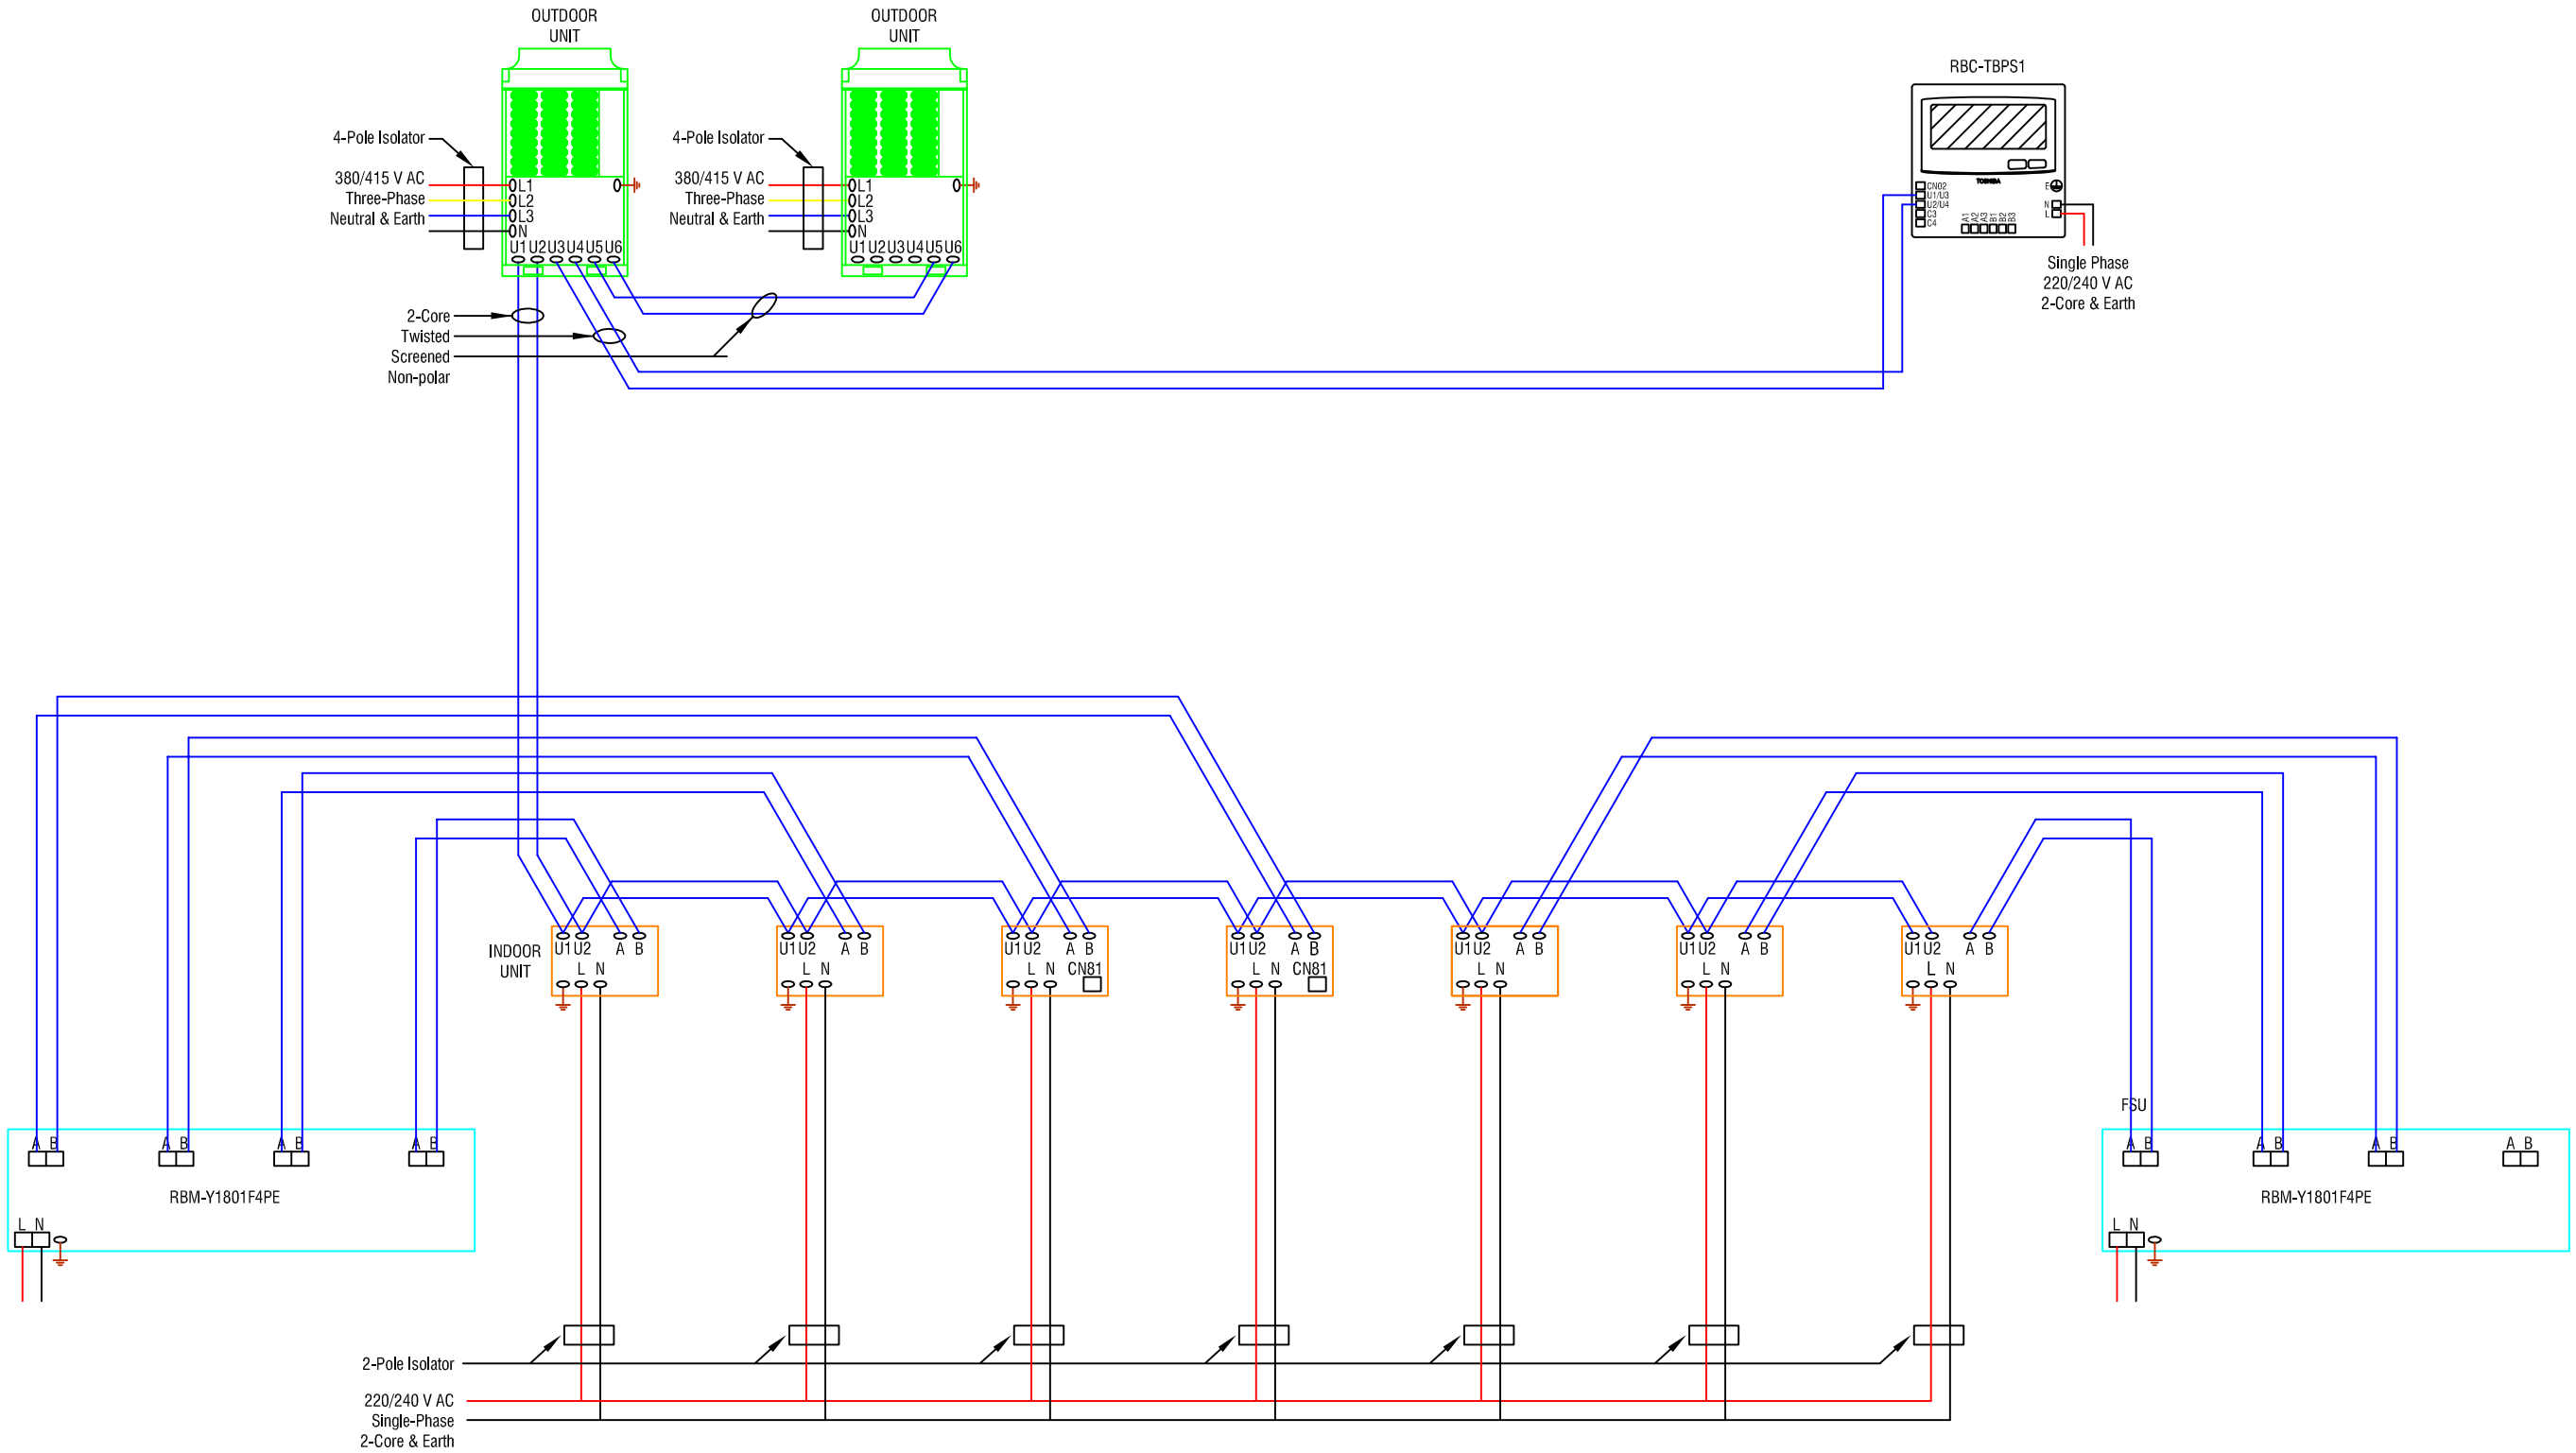

NOTES

1. IT IS THE RESPONSIBILITY OF THE CONSULTANT OR CONTRACTOR, TO CONFIRM THAT THE CONTROLS SELECTION IS CORRECT PRIOR TO INSTALLATION.
2. DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS SHOULD BE CHECKED ON SITE.
3. THIS DRAWING IS FOR INDICATION ONLY.
4. ALL CONTROLS COMPONENTS SHOULD BE FITTED INSIDE A SUITABLE ENCLOSURE.
5. ALL CABLES MUST BE SIZED ACCORDING TO CURRENT WIRING REGULATIONS.

LEGEND

L	Live Wire on Indoor Unit
N	Neutral Wire
L1, L2, L3	3 Phase Power Supply on Outdoor Unit
A, B	Remote Controller Connections
U1, U2	System Network Connections
U3, U4	Network Controller Connections
U5, U6	Outdoor Network Connections

CDL

Cool Designs Ltd
Cranford Court
Hardwick Grange, Woolston
Warrington, WA1 4RX

email: support@cooldesignsltd.co.uk

Drawing Prepared For
-
-

Project
-
-

Title
-
-
-
-

Drawn By
-

Checked By

Scale
-

Date Drawn
-

Drawing No. -

Cad File :- -