



*Pocket Quick
Reference Guide
On the **TOSHIBA***

RBC-AMS51E/54E/55E-ES

Remote Controller

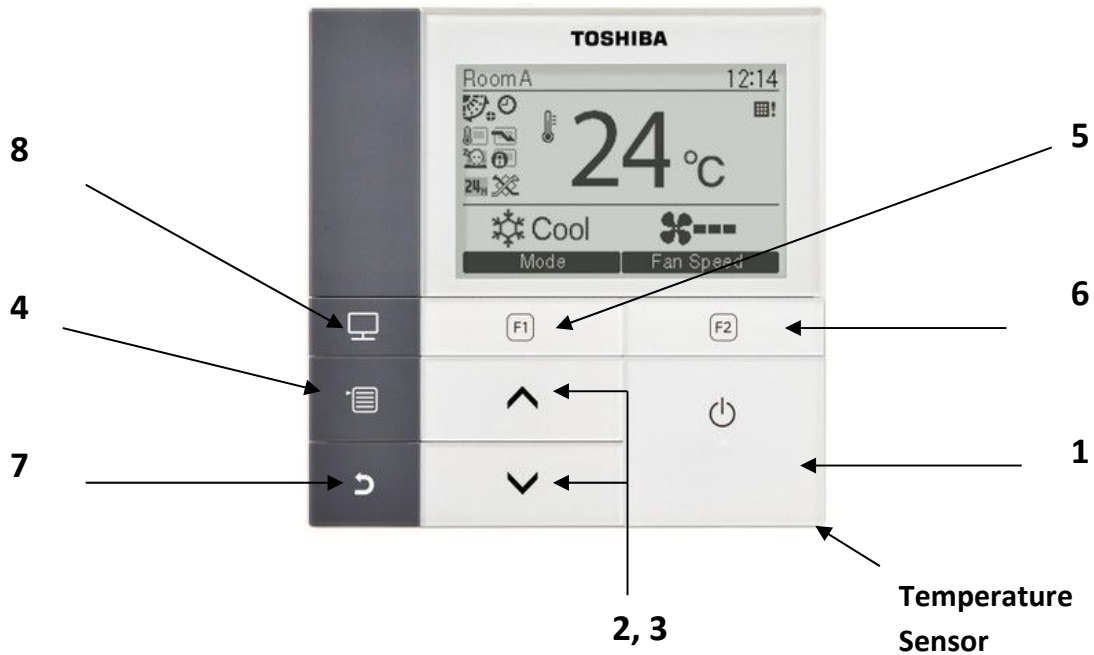


Quick Reference Guide

To assist service engineers working on Toshiba air conditioning equipment, there is a large quantity of data available via the remote controller the RBC-AMS51E/54E/55E-ES, this data is **NOT** available via an Infra-Red remote or the RBC-AS41E simplified remote controller.

Accessing the data is a simple process of entering into the on-board menu of the remote controller.

Controller Layout (RBC-AMS51E).



1 - ON/OFF button

Illuminates when system is running.

2 - Temperature up button

Used in the menu screen to select menu items

3 - Temperature down button

Used in the menu screen to select menu items

4 - Menu Button

Displays the menu screen.

5 - F1 button

Varies its functions according to the setting screen.

6 - F2 button

Varies its functions according to the setting screen

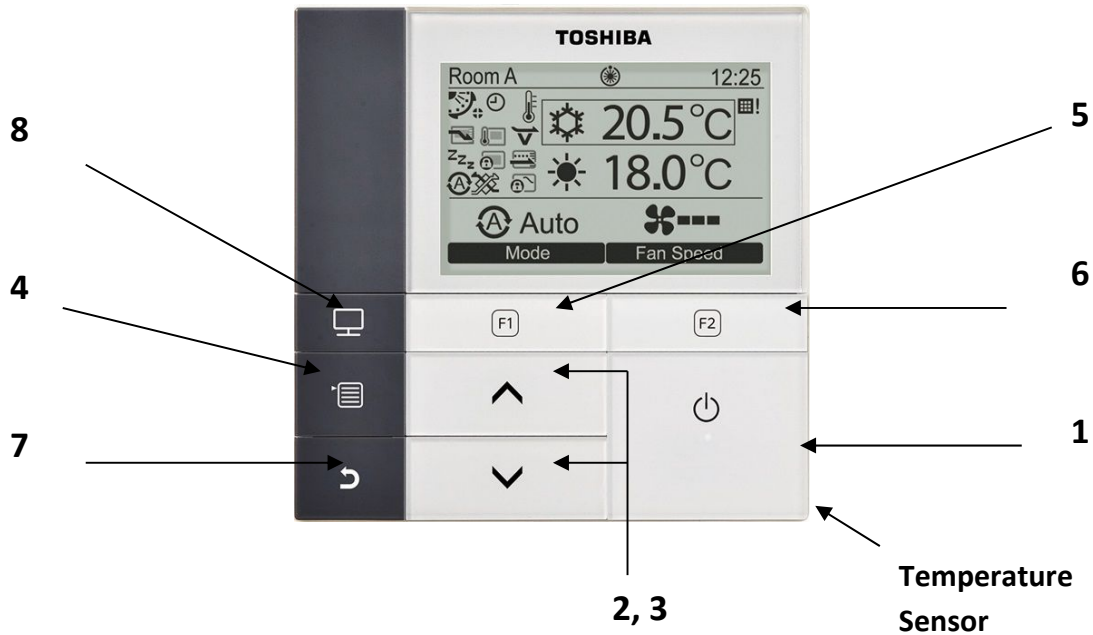
7 - Cancel button

Functions as indicated on the screen

8 - Monitor button

Displays the monitor screen

Controller Layout (RBC-AMS54E/55E-ES).



1 - ON/OFF button

Illuminates when system is running.

2 - Temperature up button

Used in the menu screen to select menu items

3 - Temperature down button

Used in the menu screen to select menu items

4 - Menu Button

Displays the menu screen.

5 - F1 button

Varies its functions according to the setting screen.

6 - F2 button

Varies its functions according to the setting screen

7 - Cancel button

Functions as indicated on the screen

8 - Monitor button

Displays the monitor screen

Differences between the RBC-AMS51E and the RBC-AMS54E/55E-ES

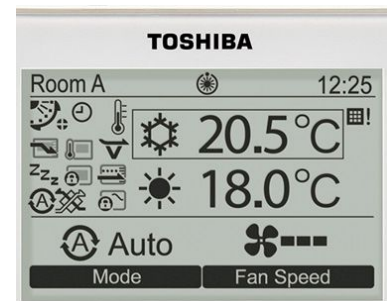


RBC-AMS51E

Toshiba replaced the RBC-AMS51E with the new RBC-AMS54E
In 2018 this was replaced with the RBC-AMS55E-ES

All versions work with RAV R32/R410A (DI and SDI)

and VRF all R410A version.



RBC-AMS54E/55E-ES

The RBC-AMS54/55E-ES E has additional functions which are available to specific products.

| New Wired Remote Controller | | | | |
|-----------------------------|-------------------------|------------------|--------------------------|-----------------------------|
| Model name | | RBC- | Current | New |
| | | | AMS51E-ES | AMS54E-ES/55E-ES |
| Monitor | Monitor | | Full Dot | ← |
| | Back Light | | Available | ← |
| | Language | | Available (11 Languages) | ← |
| | Fan Speed* | | Three | Five |
| Timer Function | Clock Setting | | Available | ← |
| | Schedule Timer | Setting Digit | 1min | ← |
| | | Setting Patterns | 8 patterns/day | ← |
| | | Holiday Setting | Available | ← |
| | | Operation Mode | N/A | Available |
| | Prevent | Setting Digit | 10min | ← |
| Setting Range | | 30~240min | ← | |
| Energy Saving | Energy Saving | Setting | 10min | ← |
| | | Patterns | 4 patterns/day | ← |
| | | Limitation | 0.50, .50~100% | ← |
| | Dual Set Point * | | N/A | Available |
| | Night Operation | | Available | ← |
| Key Lock | Key Lock | | Available | ← |
| Setting Temp | Indication Digit | | 1°C/0.5°C select | ← |
| | Range Limitation | | Available | ← |
| | Return Back | Setting Digit | 10min | ← |
| | | Setting Range | 10~120min | ← |
| | Indoor Unit Temperature | | Available | ← |
| Service Mode | Check Code | | Available | ← |
| | Indicate Model Name | | Available | ← |
| | Contact Indication | | Available | ← |
| Filter Sign | Filter Sign | | Available | Available + Clear by Manual |
| | Remaining Time | | Available | ← |

Fig 1

Dual Set Point.

In the “Auto” mode it is possible to set the upper limit for Heating mode and the lower limit for Cooling mode

Soft Cooling.

This function limits the louver position, plus Power Saving at Start-Up, which also prevent cold drafts.

Schedule Timer which also allows the mode of operation to be set.

Increased fan speeds from 3 to 5 on indoor units which allow the increased speeds.

Refrigerant Leak Indication, visual indication of refrigerant leak when coupled with one of the Toshiba leak detection systems.

Individual On/Off temperature control. Individual control of VRF indoor units via single or multi outlet Flow Selector boxes, **New “e” series ONLY**).


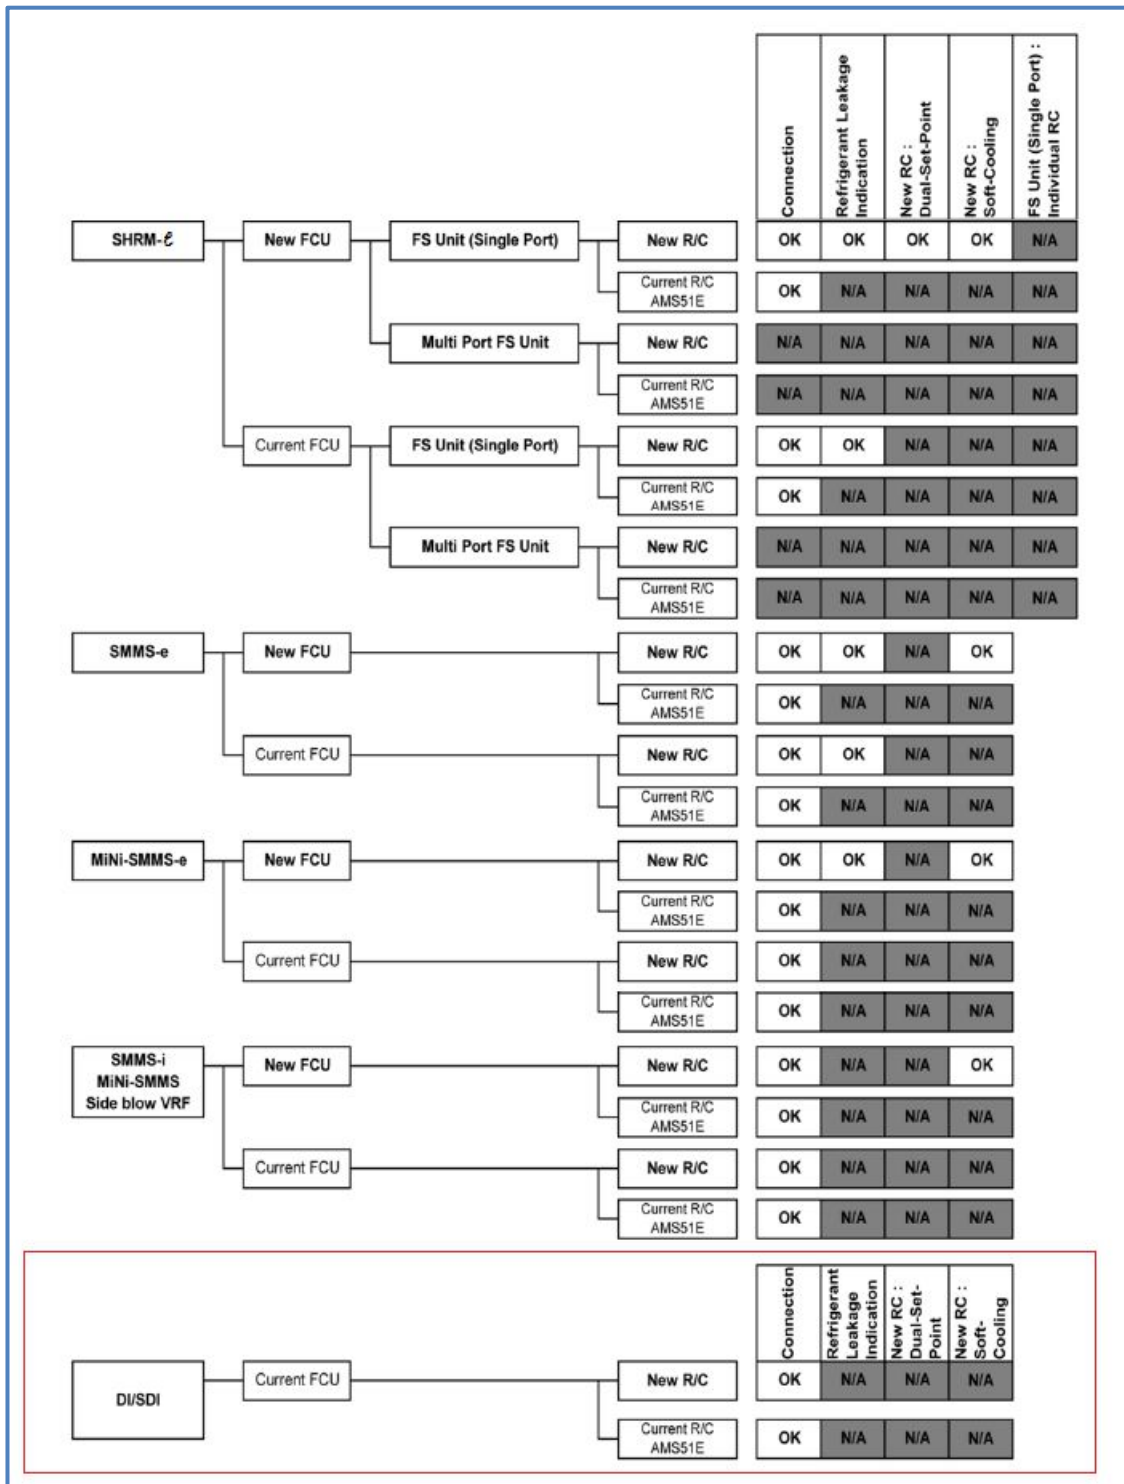
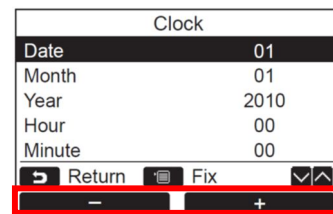
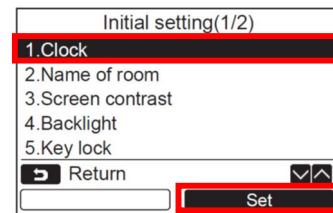


Fig 2

Setting the time and date, All models RBC-AMS51E/54E/55E-ES



Setting Present Time and Day of Week

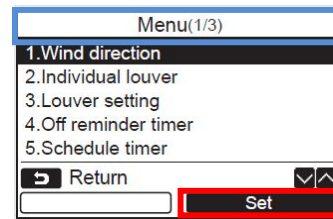- 1) Press the “ [MENU] ” button to display the “Menu screen”.
- 2) Press the “ [▲ ▲] / [▼ ▼] ” button to select option “10 Initial Setting” then Press the “ [Set] ” Set [F2]” button.
- 3) Select “1 – Clock” then press “ [Set] ” Set [F2]” button.
- 4) Press the “ [▲ ▲] / [▼ ▼] ” button to select the year, month, date & time. Press the “ [–] [F1] ” or “ [+] [F2] ” button to set the value.
- 5) Press the “ [MENU] ” button.



Setting ON and OFF Times (scheduled operations)

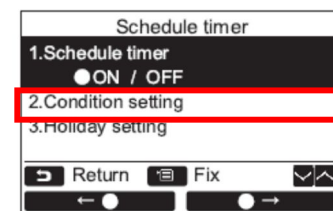
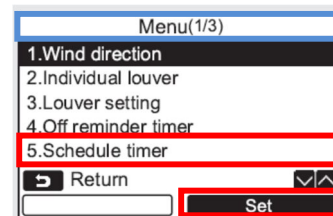
- 1) Press the “ [MENU] ” button to display the “Menu screen”.
- 2) Press the “ [▲ ▲] / [▼ ▼] ” button to select option “5 Schedule timer” then press the “ [Set] ” Set [F2]” button.
- 3) Press the “ [← ●] [F1] ” button to turn On or “ [● →] [F2] ” to turn off the schedule timer.



Setting Timer Operation Mode. In order to utilise the “Mode” facility in the scheduled timer function, i.e. set the mode of operation, the “Operation Mode” needs enabling. (Factory setting is “OFF. The equipment will turn on at the scheduled time, but the mode of operation would be at the last setting on the remote at the time of the previous “OFF” schedule).


Entering the “Field Setting Menu”

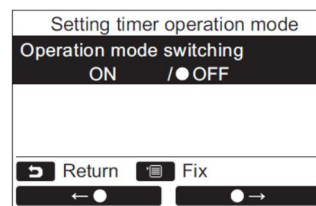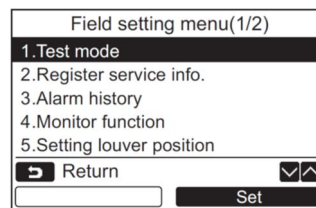- 1) Press “ [MENU] and [V V] “ together for 4 seconds.
- 2) Press “ [^ ^]/[V V] “ to select option “6” “Setting Timer Operation Mode”
- 3) Press “ [Set] [F2]”
- 4) Select “ON [←●] via [F1]” press “ [Fix (Menu Button)]” To return to the “Field Setting Menu”.




Condition Setting (Day, time, mode & temperature settings)

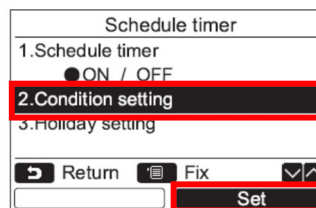Press the “ [^ ^]/[V V] “button to select option “2 Condition setting” then press the “ [Set] Set” [F2] button.





The current settings appear.


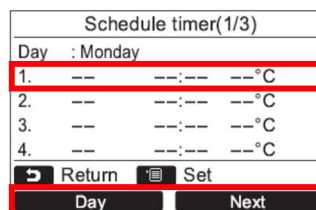
- a) Press the “ [Day] [F1]” button to confirm the settings for each day
- b) Press the “ [Next] [F2]” button to confirm the current settings, 8 different settings appear



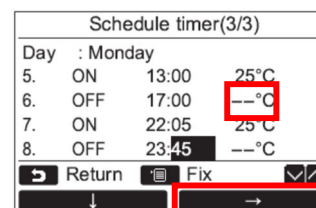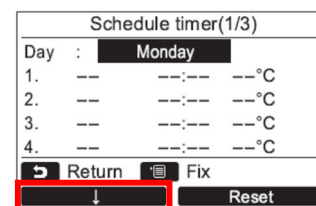- 1) Press the “ [MENU] “ button
- 2) Press the “ [^ ^]/[V V] “ button to select the day to set then press the “ [↓] [F1]” button.
- 3) Press the “ [^ ^]/[V V] “ button to select “ON / OFF”
Select “ON” to set start time and set temperature settings.
Select “OFF” to set the stop time.
“- - “indicates that item has not been set.
- 4) Press the “ [→] [F2]” button to select time or temperature. When “- - “is displayed, time or temperature cannot be selected.





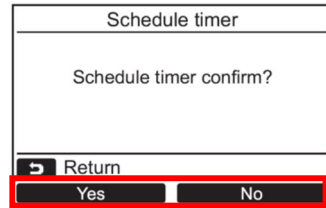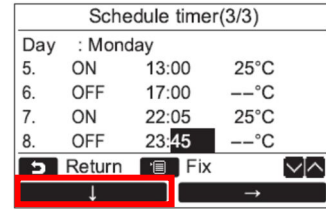- 5) Press the “ [▲ ▲] / [▼ ▼] ” button to set time or temperature.
- 6) Press the “ [↓] [F1] ” to program the next pattern. Up to 8 patterns per day can be programmed.
- 7) Press the “ [☰] MENU ” button. Screen returns to the day selection screen.
- 8) Press the “ [▲ ▲] / [▼ ▼] ” button to select the next day to set. Repeat steps 3 to 8 above to program the running patterns for each day.
- 9) Press the “ [☰] MENU ” button. Press the “ [Yes] [F1] ” to confirm. Press the “ [No] [F2] ” to return to the setting screen.





To delete the settings for each day

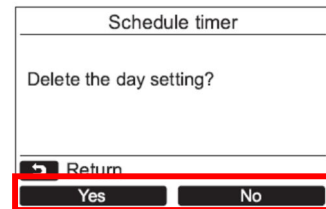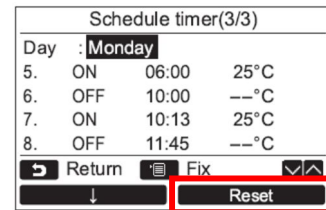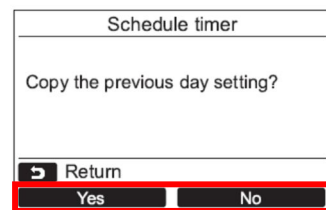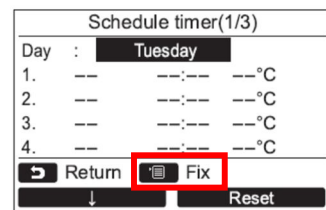- 1) Press the “ [Reset] [F2] ” button on the day selection screen.
- 2) Press the “ [Yes] [F1] ” button. The schedule for the day selected is deleted.
- 3) Press the “ [No] [F2] ” button to Return to the “Condition setting screen”











To copy the settings of the previous day.

- 1) Press the “ [☰] MONITOR ” button on the day selection screen.
- 2) Press the “ [Yes] [F1] ” button. The schedule for the previous day is copied.
- 3) Press the “ [No] [F2] ” button to Return to the “Condition setting screen”



Holiday (Day omit) setting.

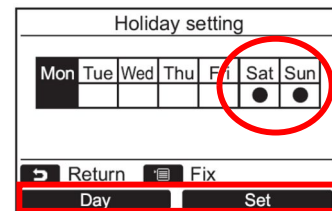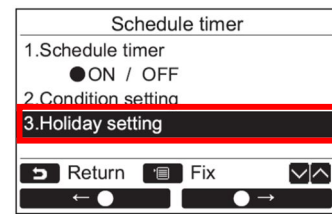- 1) From the "Scheduled timer screen"
Press the "  /  " button to
Select option "3 Holiday setting"
- 2) Press the "  [F2]" button.
- 3) Press the "  [F1] button to
select the day, and then press the "  [F2]"
button to set.
Press "  [F2]" button
So that " ● " is displayed on the day when the
Schedule timer is **NOT** used



Fault Code Guide All model's RBC-AMS51E/54E/55E-ES

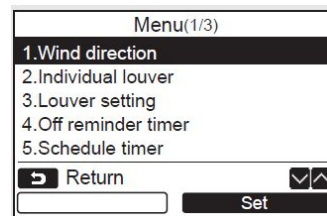


Current fault codes are displayed automatically at the top of the LCD display, (Warning symbol, Code: *** along with the affected unit no.)


Main power switch flashes “Green”.

Fault code history can be accessed by accessing the “Field Setting Menu”

1) Press the “[MENU]” button to display the menu screen



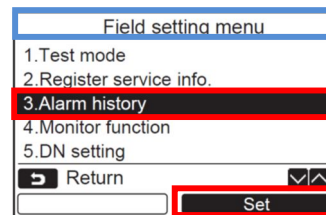2) Press and hold the” [MENU]” button and the”[]“button at the same time for more than 4 seconds to display the “Field setting menu”



3) Scroll down to item “3” using the [] button.

4) Press “F2” **Set**

| Alarm history | | | | |
|---------------|------|------|------------|-------|
| | Unit | Code | Date | Time |
| 1. | 1-2 | E04 | 31/12/2010 | 12:25 |
| 2. | - | - | - | - |
| 3. | - | - | - | - |
| 4. | - | - | - | - |

Return **Reset**

A list of the latest 10 alarm codes along with date, time and unit are displayed.

The oldest data are deleted in order to record the newest, the date and time when the error occurred for the first time are displayed for any repeated alarms.

- Refer to the *Technical Handbook for fault code diagnosis and descriptions*

To erase the fault code history.

- 1) Press the “ **Reset** [F2]” button whilst the list of alarm codes is displayed.

| Alarm history | | | | |
|---------------|------|------|------------|-------|
| Unit | Code | Date | Time | |
| 1. | 1-2 | E04 | 31/12/2010 | 12:25 |
| 2. | - | - | - | - |
| 3. | - | - | - | - |
| 4. | - | - | - | - |

Return **Reset**

- 2) When the display has changed press the “ **Yes** [F1]” button.

| Alarm history | |
|-----------------------|--|
| Reset all alarm data. | |

Return **Yes** **No**

| Code | Description |
|------|---|
| E01 | No communication between remote controller and indoor unit. (Master indoor unit maybe switched off) |
| E02 | Local controller failure – unable to transmit |
| E03 | Master indoor unit receives no data to A-B (Could also show as E01 fault) |
| E04 | Indoor unit (except twin slave) receives no communications from outdoor unit; can also include klixon on discharge pipe of outdoor unit |
| E08 | Duplicated indoor unit address |
| E09 | 2 local controllers connected on a group – both configured as masters |
| E10 | Indoor unit PCB failure |
| E18 | Communications failure between master indoor unit and slave indoor unit or units |
| F01 | Indoor unit TCJ (Liquid) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F02 | Indoor unit TC2 (Vapour) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F04 | Outdoor unit TD (Discharge) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F06 | Outdoor unit TE (Coil) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F08 | Outdoor unit TO (Ambient) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F10 | Indoor unit TA (Return Air) sensor error (Open or Closed circuit – resistance is measured in kΩ |
| F29 | Indoor unit PCB failure |
| H01 | Outdoor unit Inverter compressor over current detected |
| H02 | Master outdoor unit over current detected shortly after start up |
| H03 | Current detected on Master outdoor unit whilst idle |
| H06 | Outdoor unit Low pressure detected by Ps sensor (0.2 bar – 2.9 psig) |
| L03 | Indoor unit Duplicated master indoor units in a group |
| L07 | Indoor unit in a group of units previously addressed as a single unit – check addressing |
| L08 | Indoor units addresses not set – check addressing |
| L09 | Indoor units capacity not set (check DN Code 11) |
| L29 | Outdoor unit IPDU error (Number of detected IPDU units is reduced) |
| L30 | Input on indoor PCB CN80 circuit for 1 minute |
| L31 | Outdoor unit PCB error |
| P01 | Indoor unit fan motor error |
| P03 | Outdoor unit High discharge temperature (TD1 exceeded 115 °C) |
| P04 | Outdoor unit High pressure switch activated (Detected by high temperature on TE sensor on digital/super digital inverter units) |
| P07 | Outdoor unit PCB heat sink overheated (Temperature over 90 °C recorded) |
| P10 | Indoor unit Float switch activated |
| P12 | Indoor unit fan motor error – detected by feedback circuit |
| P19 | Wrong change in temperature recorded (4 way valve error) |
| P22 | Outdoor unit fan motor IPDU error |
| P26 | Outdoor unit Giant transistor short circuit |
| P29 | Outdoor unit Compressor error detected by feedback circuit |
| P30 | Indoor unit Group control follower unit error / duplicated central control addresses |
| P31 | Indoor unit PCB error |
| C05 | Central control Sending error in TCC-Link central control device |
| C06 | Central control Receive error in TCC-Link central control device |
| C12 | Batch alarm for general purpose equipment interface |

Fig 3

Data Retrieval Guide

There are two levels for system data, the first level is the monitor mode, which shows basic temperatures indoor and outdoor, filter time and system running hours.

To access this data press the **[MONITOR]** button

| Monitor | |
|---|-------|
| (1) Set temp. | 27°C |
| (2) Indoor temp. | 27°C |
| (3) Outdoor temp. | 35°C |
| (4) Filter remaining hour | 2500 |
| (5) Total running hour | 60000 |
| Return | |
| <input style="width: 100px; height: 20px;" type="text"/> <input style="width: 100px; height: 20px;" type="text"/> | |

- 1) Display's the set temperature.
- 2) Display's the temperature measured by the TA return air sensor within the indoor unit. If the system is programmed to use the room sensor in the remote controller this will be displayed replacing the TA data.
- 3) Display's the temperature measured by the TO ambient air sensor within the outdoor unit.
- 4) Display's the remaining time until the filter sign is displayed.
- 5) Display's the accumulated operating time of the system.

To access the second level of data display.

- 5) Press the **[MENU]** button to display the **"Menu screen"**

| Menu(1/3) | |
|--|--|
| 1.Wind direction | |
| 2.Individual louver | |
| 3.Louver setting | |
| 4.Off reminder timer | |
| 5.Schedule timer | |
| Return | |
| <input style="width: 100px; height: 20px;" type="text"/> <input style="width: 100px; height: 20px; border: 2px solid red;" type="text" value="Set"/> | |

- 6) Press and hold the **"[MENU]"** button and the **"[↓ ↓]"** button at the same time for more than 4 seconds to display the **"Field setting menu"**

| Field setting menu | |
|--|--|
| 1.Test mode | |
| 2.Register service info. | |
| 3.Alarm history | |
| 4.Monitor function | |
| 5.DN setting | |
| Return | |
| <input style="width: 100px; height: 20px;" type="text"/> <input style="width: 100px; height: 20px; border: 2px solid red;" type="text" value="Set"/> | |

- 7) Scroll down to item **"4"** using the **"[↓ ↓]"** button.

- 8) Press **"F2 [Set]"**

| Monitor function | |
|---|------|
| Code | Data |
| 00 | 0024 |
| Return | |
| <input style="width: 100px; height: 20px;" type="text"/> <input style="width: 100px; height: 20px;" type="text"/> | |

- 9) Press the **"[↑ ↑]/[↓ ↓]"** to scroll through the codes, for details of codes refer to the following charts.

Data is available for "0, 1, 2, 3, 4, 5 & 7 series - R410A & 1 Series R32" Digital/Super Digital Inverter and VRF equipment (Mini -SMMS, Mini SMMSe, SMMS, SMMSi, SMMSe, SHRM, SHRMi & SHRMe).

Digital/Super digital “0-1-2-3 – R410A” series data

| Code | Indoor Data | Code | Outdoor Data |
|------|-------------------------------------|------|-------------------------------------|
| 00 | Room Temp (Control Temp) (°C) | 60 | TE Sub-cooled Liquid Temp. (°C) |
| 01 | Room Temp. (Remote Controller) (°C) | 61 | TO Ambient Temp. (°C) |
| 02 | TA Return Air Temp. (°C) | 62 | TD Discharge Temp. (°C) |
| 03 | TC Coil – Vapour Temp. (°C) | 63 | TS Suction Temp. (°C) |
| 04 | TCJ Coil – Liquid Temp. (°C) | 65 | THS – Inverter Heat Sink Temp. (°C) |

Fig 4

Digital/Super digital “4,5,7 – R410A & 1 – R32” series

| Code | Indoor Data | Code | Outdoor Data |
|------|---|------|-------------------------------------|
| 00 | Room Temp (Control Temp) (°C) | 60 | TE Sub-Cooled Liquid Temp. (°C) |
| 01 | Room Temp. (Remote Controller) (°C) | 61 | TO Ambient Temp. (°C) |
| 02 | TA Return Air Temp. (°C) | 62 | TD Discharge Temp. (°C) |
| 03 | TC Coil – Vapour Temp. (°C) | 63 | TS Suction Temp. (°C) |
| 04 | TCJ Coil – Liquid Temp. (°C) | 65 | THS – Inverter Heat Sink Temp. (°C) |
| 07 | Fan Speed (rpm) | 6A | Operation Current (A) |
| F2 | Fan Run Time (x 100h) | 70 | Compressor Frequency (Hz) |
| F3 | Filter Duration Timer (x 1h) | 72 | Fan Speed (Lower) – (rpm) |
| F8 | Discharge Temp. (Indoor – If fitted) (°C) | 73 | Fan Speed (Upper) – (rpm) |
| | | F1 | Compressor Run Time (x 100h) |

Fig 5

VRF indoor data for Mini SMMS / SMMS / SMMSI & SHRM equipment

| Code | Indoor Data | Code | Indoor Data |
|------|-------------------------------------|------|--|
| 00 | Room Temp (Control Temp) (°C) | 06 | Indoor Discharge Temp (If Used) - (°C) |
| 01 | Room Temp. (Remote Controller) (°C) | 08 | PMV Position (0 – 10) |
| 02 | TA Return Air Temp. (°C) | 0A | Number of Connected Indoor Units (No.) |
| 03 | TCJ Coil – Liquid Temp. (°C) | 0b | Indoor Capacity (x 10 = HP) |
| 04 | TC2 Coil – PMV Pipe Temp. (°C) | 0C | Number of Outdoor Units (No.) |
| 05 | TC1 Coil – Vapour Temp (°C) | 0d | Outdoor Capacity (x 10 = HP) |

Fig 6

VRF Outdoor data for Mini SMMS / SMMS & SHRM equipment

| Code | Outdoor Data | Code | Outdoor Data |
|------|---|------|--|
| *0 | Td1 - Compressor 1 Discharge Temp. (°C) | *8 | TU – Low Pressure Saturated Temp. (°C) |
| *1 | Td2 - Compressor 2 Discharge Temp. (°C) | *9 | Compressor 1 Current (A) |
| *2 | Pd – High Pressure Sensor (MPa) | *A | Compressor 2 Current (A) |
| *3 | Ps - Low Pressure Sensor (MPa) | *b | PMV1 + 2 Opening (0 – 100) |
| *4 | TS – Suction Temp. (°C) | *d | Compressor 1, 2 ON/OFF |
| *5 | TE - Outdoor Heat Exchanger Temp. (°C) | *E | Outdoor Fan Mode (0 – 31) |
| *6 | TL – Liquid Temp. (°C) | *F | Outdoor Unit Size (HP) |

Note. * Would be replaced with 1, 2, 3 or 4 to obtain data from respective outdoor unit.

Fig 7

VRF Outdoor data for SMMSi/SHRMI equipment

| Code | Outdoor Data | Code | Outdoor Data |
|------|---|---|--|
| *0 | Pd – High Pressure Sensor (MPa) | #0 | Compressor 1 Revolutions (rps) |
| *1 | Ps – Low Pressure Sensor (MPa) | #1 | Compressor 2 Revolutions (rps) |
| *2 | Td1 – Compressor 1 Discharge Temp. (°C) | #2 | Compressor 3 Revolutions (rps) |
| *3 | Td2 – Compressor 2 Discharge Temp. (°C) | #3 | Outdoor Fan Mode |
| *4 | Td3 – Compressor 3 Discharge Temp. (°C) | #4 | Compressor IPDU 1 Heat Sink Temp. (°C) |
| *5 | TS – Suction Temp. (°C) | #5 | Compressor IPDU 2 Heat Sink Temp. (°C) |
| *6 | TE1 – Outdoor Coil Temp. (°C) | #6 | Compressor IPDU 3 Heat Sink Temp. (°C) |
| *7 | TE2 – Outdoor Coil Temp. (°C) | #7 | Outdoor Fan IPDU Heat Sink Temp. (°C) |
| *8 | TL – Liquid Temp. (°C) | #8 | Heating / Cooling Recovery Controlled |
| *9 | TO – Outdoor Ambient Temp. (°C) | #9 | Pressure release |
| *A | PMV 1 + 2 Opening | #A | Discharge Temp. Release |
| *B | PMV 4 Opening | #B | Follower Unit Release |
| *C | Compressor 1 Current (A) | #F | Outdoor Unit Size (HP) |
| *D | Compressor 2 Current (A) | Note. * Would be replaced with 1, 2, 3 or 4 to obtain data from respective outdoor unit. # would be replaced with either 5, 6, 7, 8 to obtain data from outdoor units 1,2,3 or 4 | |
| *E | Compressor 3 Current (A) | | |
| *F | Outdoor Fan Current (A) | | |
| | | | |

Fig 8

VRF Outdoor data for SMMSe & SHRMe equipment

| Code | Outdoor Data | Code | Outdoor Data |
|------|---|---|---|
| *0 | Pd – High Pressure Sensor (MPa) | #0 | PMV 1 Opening (PIs) |
| *1 | Ps – Low Pressure Sensor (MPa) | #1 | PMV 3 Opening (PIs) |
| *2 | Td1 – Compressor 1 Discharge Temp. (°C) | #2 | PMV 4 Opening (PIs) |
| *3 | Td2 – Compressor 2 Discharge Temp. (°C) | #3 | 1 Fan model: Compressor 1 current 2 Fan model: Comp. 1 and Outdoor fan current (A) |
| *5 | TE1 – Outdoor Coil Temp. (°C) | #4 | 1 Fan model: Compressor 2 current 2 Fan model: Comp. 2 and Outdoor fan current (A) |
| *6 | TE2 – Outdoor Coil Temp. (°C) | #6 | Compressor 1 Revolutions (RPS) |
| *7 | TG1 – Outdoor Coil Temp. (°C) | #7 | Compressor 2 Revolutions (RPS) |
| *8 | TG2 – Outdoor Coil Temp. (°C) | #9 | Outdoor Fan mode |
| *9 | TO – Outdoor Ambient Temp. (°C) | #A | Compressor IPDU 1 heat sink temp. (°C) |
| *A | TS1 – Suction Temp. (°C) | #B | Compressor IPDU 2 heat sink temp. (°C) |
| *C | TS3 – Suction Temp. (°C) | #D | Outdoor Fan IPDU 1 heat sink temp. (°C) |
| *D | TL1 – Liquid Temp. (°C) | #E | Outdoor Fan IPDU 2 heat sink temp. (°C) |
| *E | TL2 – Liquid Temp. (°C) | #F | Outdoor Unit Size (HP) |
| *F | TL3 – Liquid Temp. (°C) | Note. * Would be replaced with 1, 2 or 3 to obtain data from respective outdoor unit. # would be replaced with either 5, 6, 7 to obtain data from outdoor units 1,2 or 3 | |
| | | | |


















Fig 9

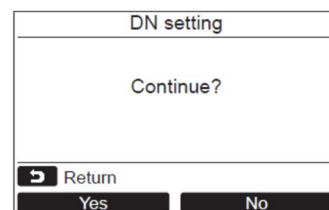
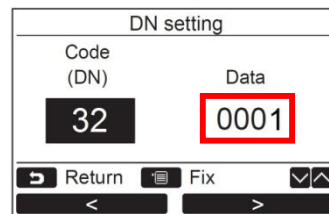
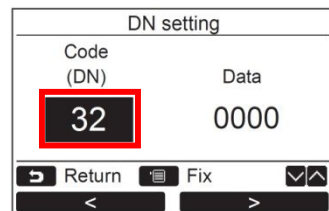
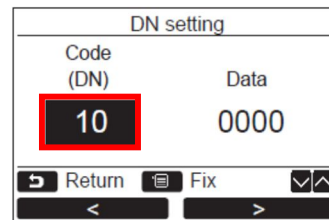
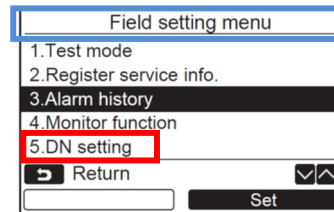
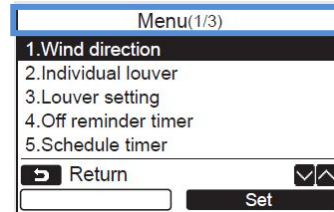
For more detailed descriptions please refer to the relevant technical service manual.

Common Configurable Control Options


















*Accessed via Toshiba hard wired remote controller RBC-AMS51E-ES/54E/55E-ES

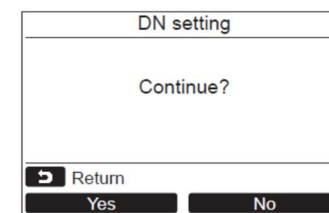
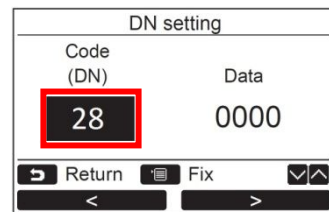
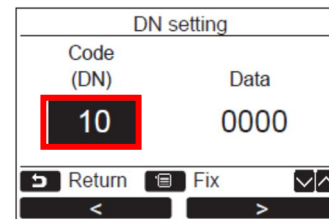
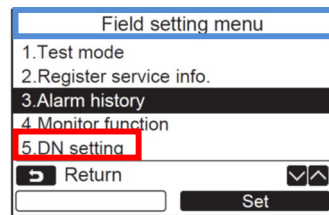
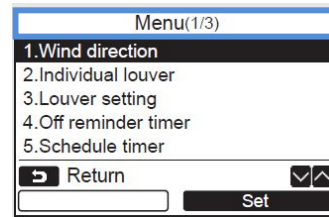
Relocation of room temperature sensing from return air to remote controller sensor

- 1) Press the “[ MENU]” button to display the “Menu screen”
- 2) Press and hold the “[ MENU]” button and the “[ ]” button at the same time for more than 4 seconds to display the “Field setting menu”
- 3) Scroll down to item “5 (RBC-AMS51E) 7 (RBC-AMS54/55E-ES)” using the “[ ]” button.
- 4) Press “F2”  Code (DN) 10 will be highlighted on the left of the display.
- 5) Scroll the Code (DN) to 32 using the “[ ]/[ ]” buttons.
- 6) When Code (DN) 32 is highlighted on the left press “ [F2]” to highlight “Data” on the right.
- 7) Change “Data” from “0000” to “0001” by pressing the “[ ]/[ ]”
- 8) Press “” follow on screen instructions.




Automatic restart after power failure

- 9) Press the “[ MENU]” button to display the “Menu screen”
- 10) Press and hold the “[ MENU]” button and the “[ ]” button at the same time for more than 4 seconds to display the “Field setting menu”
- 11) Scroll down to item “5 (RBC-AM551E) 7 (RBC-AM54/55E-ES)” using the “[ ]” button.
- 12) Press “F2”  Code (DN) 10 will be highlighted on the left of the display.
- 13) Scroll the Code (DN) to 28 using the “[ ]/[ ]” buttons.
- 14) When Code (DN) 32 is highlighted on the left press “ [F2]” to highlight “Data” on the right.
- 15) Change “Data” from “0000” to “0001” by pressing the “[ ]/[ ]”
- 16) Press “” follow on screen instructions.



Energy Saving Function.




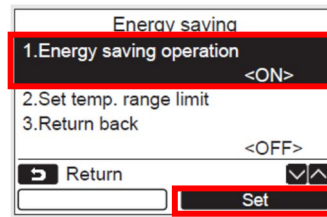
- 1) Press the “**[MENU]**” button to display the “**Menu screen**”
- 2) Press the “ **[▲ ▲]/[▼ ▼]** “ button to Select option “9 Energy Saving”
- 3) Press the “ **Set** [F2]” button.



| Item | Function |
|----------------------------|--|
| 1. Energy Saving Operation | Perform the power saving operation of the air conditioner |
| 2. Set temp. Range limit | Set the temperature range limit of the remote controller operation |
| 3. Return Back | Set the function that changes the temperature back to the specified temperature automatically if the temperature has been changed at the remote controller |



Energy Saving Ratio.

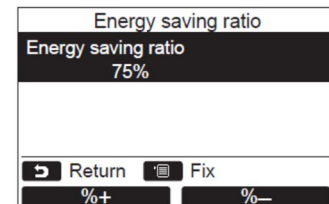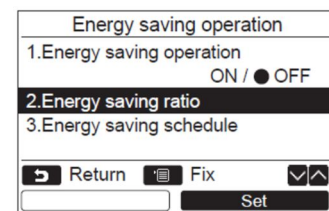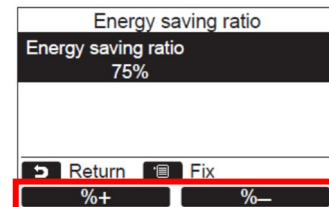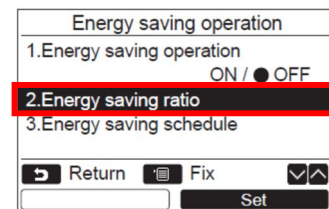- 1) Press the “ **[▲ ▲]/[▼ ▼]** “ button to Select option “2 Energy Saving Ratio”
- 2) Press the “ **%+ [F1]** or “ **%- [F2]** to set the value.
The energy saving ratio can be set within the range from 50% to 100% by 1% increments.
The lower the value is set, the higher the power saving effect.
- 3) Press the “ **[MENU]**” button.
“ **Setting**” appears, and then the screen returns To the “Energy saving operations” screen.
- 4) Press the “ **[▲ ▲]/[▼ ▼]** “ button to Select the item to set
- 5) Press the “ **Set** [F2]” button.







Energy Saving Temperature Setting.

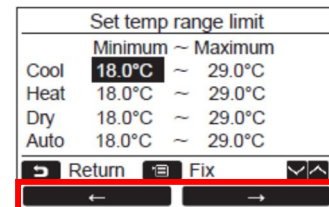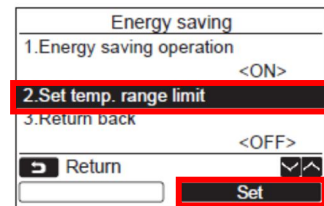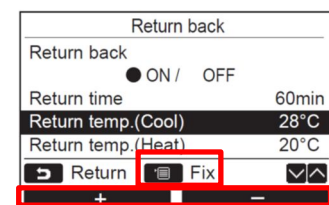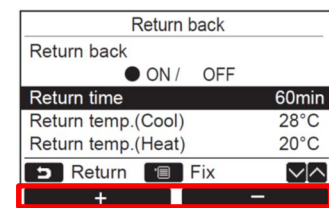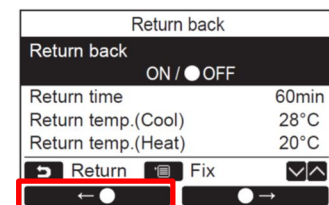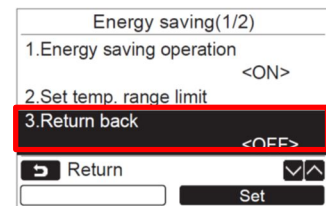- 1) Press the “ [▲ ▲]/[▼ ▼] ” buttons to Select “2.Set temp range limit” on the “Energy Saving” Screen, and then press the “ **Set** [F2] ” button.
- 2) Press the “ [▲ ▲]/[▼ ▼] ” button to set the temperature.
Press the “ **-** [F1] or **→** [F2] ” button to set the value.
- 3) Press the “ [MENU] ” button.
The screen returns to the “Energy Saving Screen”
“ ⏸ Setting ” appears, and then the screen returns to the “Energy saving operations” screen.










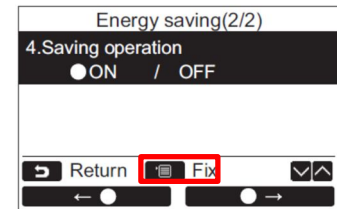
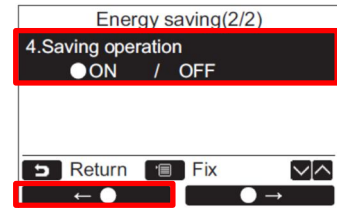
Return Back. This function returns the system to a pre-set temperature for both heating and cooling, after a programmed period of time between 10 minutes and 120 minutes in 10-minute increments.

- 1) Press the “ [▲ ▲]/[▼ ▼] ” buttons to Select “3. Return Back ” on the “Energy Saving” Screen, and then press the “ **Set** [F2] ” button.
- 2) Press the “ **←●** [F1] ” button to select ON.
- 3) Press the “ [▲ ▲]/[▼ ▼] [F1] ” button to select “Return Time”.
then press “ **+** [F1] **-** [F2] ” buttons to set the duration (10 – 120 Minutes)
- 4) Press the “ [▲ ▲]/[▼ ▼] [F1] ” button to select “Return temp (cool) or Return temp (heat)”.
then press “ **+** [F1] **-** [F2] ” buttons to set the temperature.
- 5) Press the “ [MENU] ” button, to fix and return to the “Energy Saving Screen”.



Saving Operation

- 1) Press the “ [ ] / [ ] ” buttons to select “4. Saving Operation” on the “Energy Saving” screen, and then press the “  [F2] ” button.
- 2) To set the “Saving Operation”, press the “  [F1] ” button to select “ON”.
- 3) Press the “ [ MENU] ” button, to fix and return to the “Energy Saving Screen”.



Note.

The saving operation is performed by determining a comfort state within the room from data such as the average room temperature, air speed, outdoor temperature for the past 20 minutes and then automatically correcting the temperature set point within a range in which there will be no significant variation in the level of comfort.


The temperature ranges for automatic correction are +1.5°C to -1.0°C when cooling and -1.5oC to +1.0oC when heating. The temperature set point indication on the remote controller does not change.


“” is displayed on the remote controllers display screen during the saving operation.

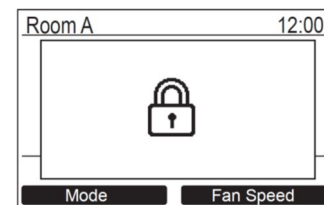
The saving operation is performed when Auto (cooling/heating automatic operation), cooling operation and heating operation. The saving operation may be possible depending on the indoor unit that is connected.

The saving operation cannot be set on the follower remote controller when a dual remote controller is used.

KEY LOCK The controller is equipped with a “Key Lock” function, this is NOT a password protected function, best described as being a “Child Lock”.


To activate the “Key Lock”, press and hold the “ [ CANCEL] ” button for more than 4 seconds.

To de-activate, press and hold the “ [ CANCEL] ” button for more than 4 seconds.



Additional information. On the top part of the RBC-AMS54E controllers display, during certain conditions a symbol may be displayed.

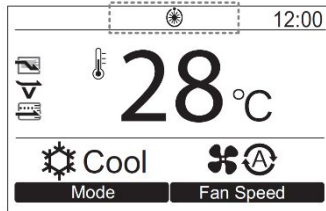- The “☀️ Preparing to heat” icon appears when the heating operation starts or when defrosting operation. The indoor fan stops or the operation becomes the blowing operation when it is displayed.
- It may be displayed depending on the model when “🔌 Preparing to operate” is displayed.




In addition to the functions and facilities listed above the RBC-AMS51/54E/55E-EN(ES) also has the capacity to control a number of functions when coupled with appropriate ventilation units.

NOTE: Not suitable for connection “1 on 1” with Toshiba VN-M*HE units.**

Ventilation.

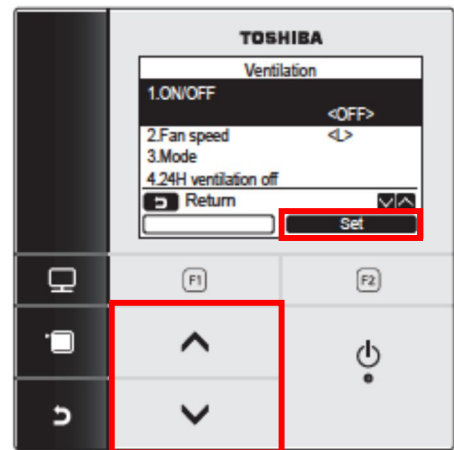- 1) Press the “ [^ ^] / [v v] ” button, scroll menu and select “11 Ventilation”.
- 2) Then press the “ Set ” button. “[F2]” button.
- 3) Press the “ [^ ^] / [v v] ” button to select the item to set
- 4) Press the “ Set ” [F2]” button.



| Item | Function |
|------------------------|--|
| 1. ON/OFF | Run and Stop operation of the ventilation unit |
| 2. Fan Speed | Setting of the fan speed |
| 3. Mode | Setting of the ventilation units mode of operation |
| 4. 24H Ventilation OFF | Setting of the 24 hour ventilation operation stop time |

















Note.

- “Impossible” appears on the display when no ventilation unit is connected or the individual operation for the ventilation unit is not activated.
- “2 – Fan Speed” or “3 – Mode”, “4 – 24H Ventilation off” is available only for the air conditioning system using the Toshiba Air to Air Heat Exchanger VN-M*HE series.
- “🔧” appears on the detailed display during the ventilation operation when the ventilation unit other than the Toshiba Air to Air Heat Exchanger VN-M*HE series is used and the individual operation for the ventilation unit is activated.

Additional facilities available on the RBC-AMS54E-EN(ES)

Dual Set Point.

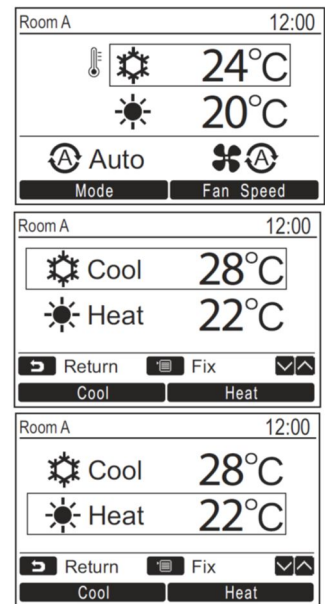
In dual set point settings, it is possible to set the temperature set point of individual modes. Subject to connected equipment, please refer to fig 2, earlier in this publication.

- 1) Press the “ [ ] / [ ] “ button to switch the display shown on the right.
- 2) To set the cooling temperature set point, press “Cool” and adjust the setting with the “ [ ] / [ ] “ a box will surround “ [ **Cool**] “ and temperature set point.
To set the heating temperature set point press “Heat” and adjust the setting with the “ [ ] / [ ] “ a box will surround “ [ **Heat**] “ and temperature set point.
- 3) Press “ [ **MENU**] “ button to confirm settings and return to normal display.
- 4) Press “ [ **CANCEL**] “ button to cancel the settings and return to the normal display.

Note

When connected to a system which does not support dual set point, the temperature set point, a value half of the heating and cooling temperature set point is displayed.

When temperature setting has been changed by the “Unsupported controller”, the cooling and heating set point displayed will be set automatically.



Increased fan speeds Available on 6 and 7 series units, fan speeds increase from 3 to 5, when used on earlier models with 3 speed fans, only 3 options are displayed.

Refrigerant Leak Indication, visual indication of refrigerant leak when coupled with one of the Toshiba leak detection systems.

Individual On/Off temperature control. Individual control of VRF indoor units via single or multi outlet Flow Selector boxes, **New “SHRMe” series ONLY**)

Notes

Contact details:

Cool Designs Ltd Technical Support

07590 775510 / 07706 293028

Monday – Friday 07.30 to 19.30



Email: support@cooldesignsltd.co.uk

Web site: www.cdlweb.info

Toshiba Air Conditioning

24/7 technical support

0870 843 0333 (Option 7)

Text back service

07624 803 017

(Type fault code in lower case no spaces)



[Try our on-line training videos on YouTube.](#)

OCool Designs Ltd reserves the right to change the product specifications, data and images without notice



Cool Designs Ltd

Raising the Standards in Air Conditioning Distribution